



# 1500 - 3000kVA TRANSFORMER PAD DETAIL

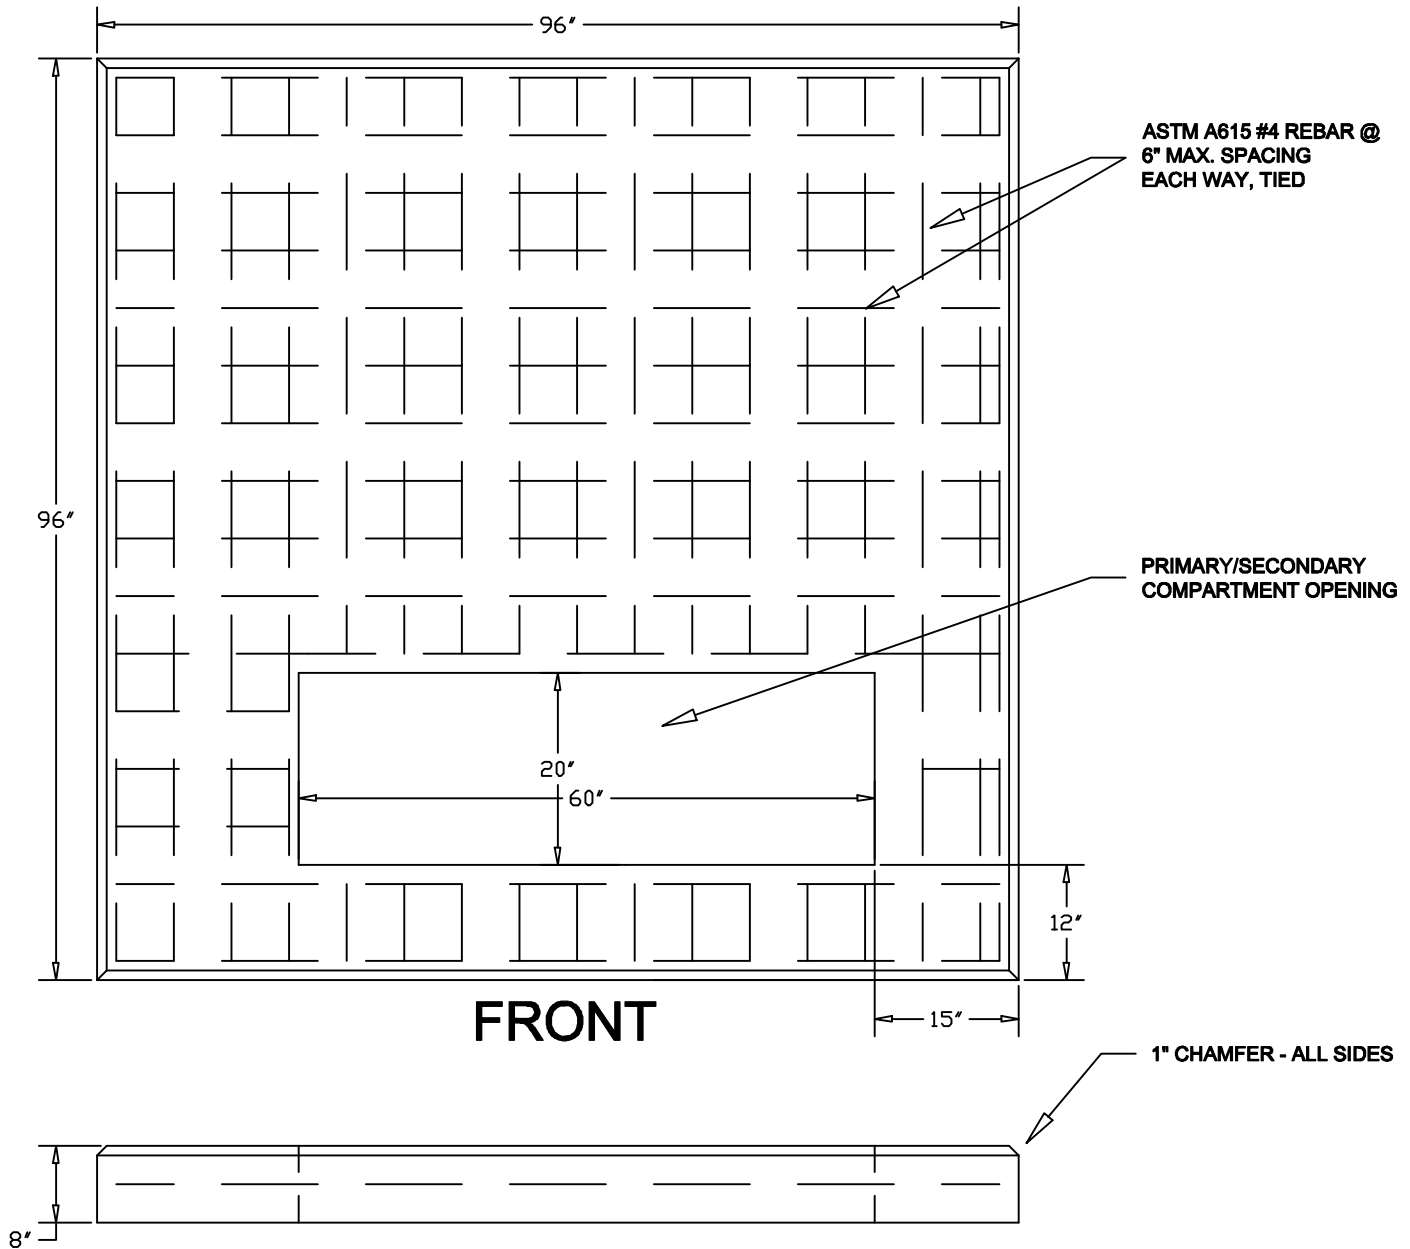

## NOTES:

1. CONCRETE TESTING TO 4,000 PSI, 4-6% MAXIMUM AGGREGATE SIZE
2. REBAR SHALL BE CENTERED IN PAD WITH MIN. 2" EMBEDMENT
3. WOOD FLOAT FINISH, NO DEPRESSIONS.


## 3.5" SECONDARY CONDUITS

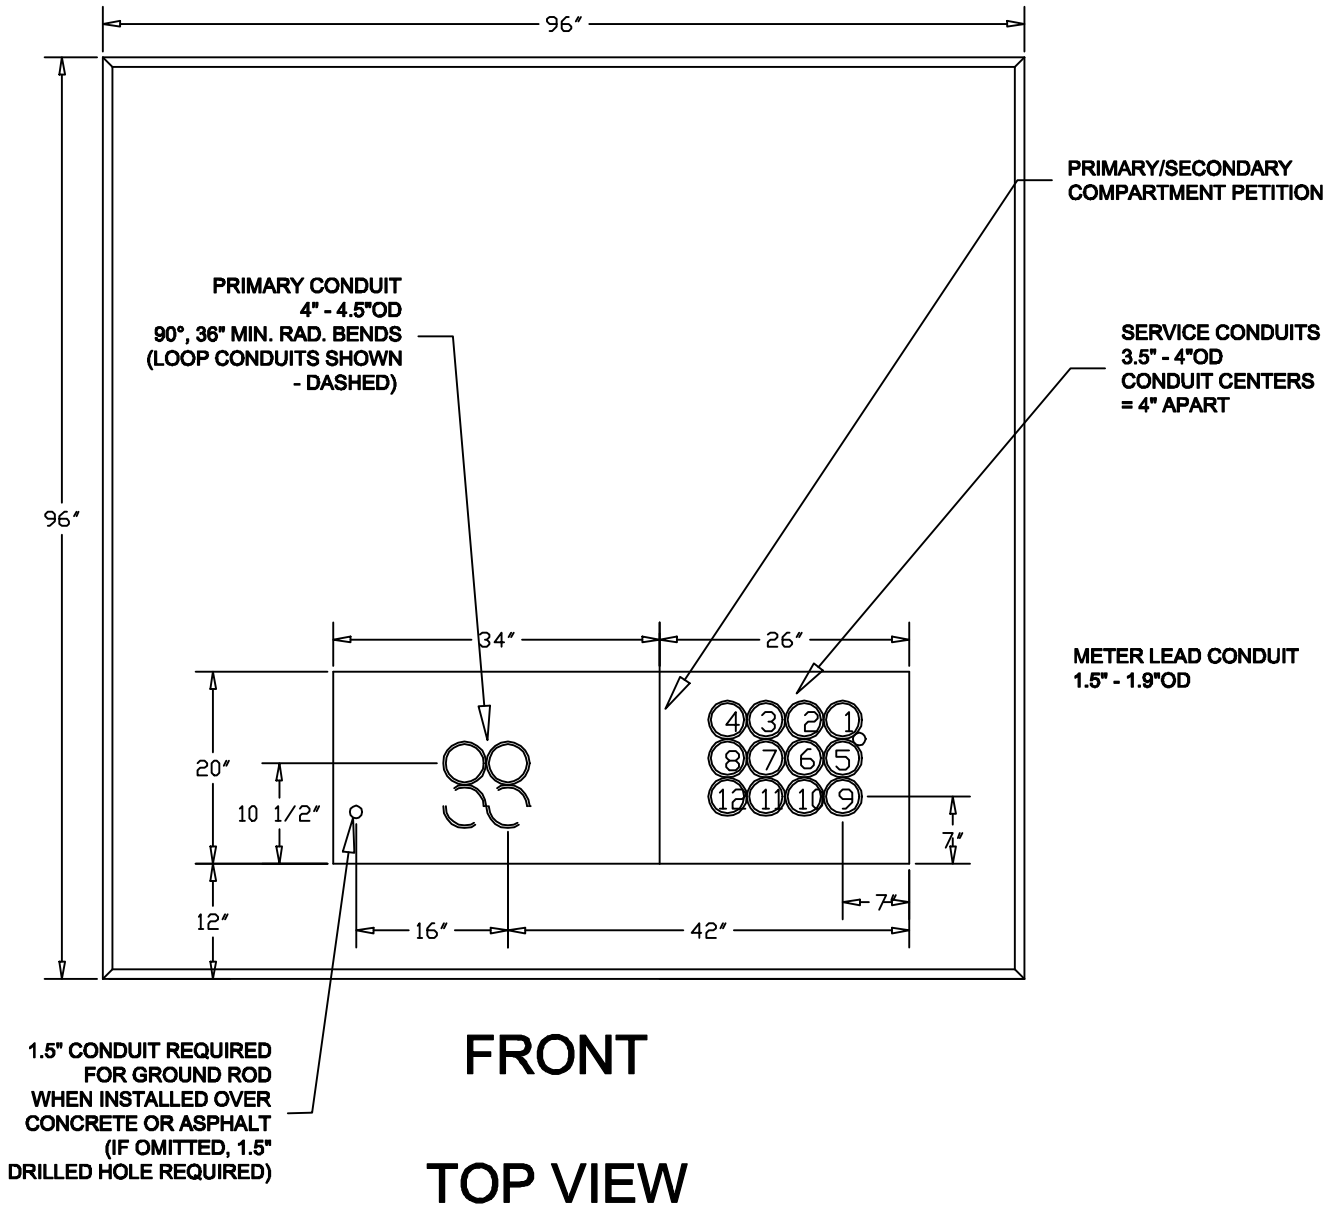

**NOTES:**

1. PLEASE REFER TO 1500-3000 T/F DRAWING FOR POURED IN PLACE PAD REQUIREMENTS.
2. CUSTOMER/CONTRACTOR TO FURNISH ALL NEMA 2-HOLE SERVICE CONNECTORS. INSTALLED BY NORTHCENTRAL.
3. 1,500KVA TRANSFORMER LIMITED TO 10 CONNECTIONS/8 WITH CTs INSTALLED IN TRANSFORMER.
4. CONDUITS SHALL BE INSTALLED IN ORDER SPECIFIED PER DRAWING
5. PLEASE SEE T/F CONN CHART FOR TYPICAL MAXIMUM NUMBER OF CONNECTIONS FOR T/F SIZE.


## 4" SECONDARY CONDUITS

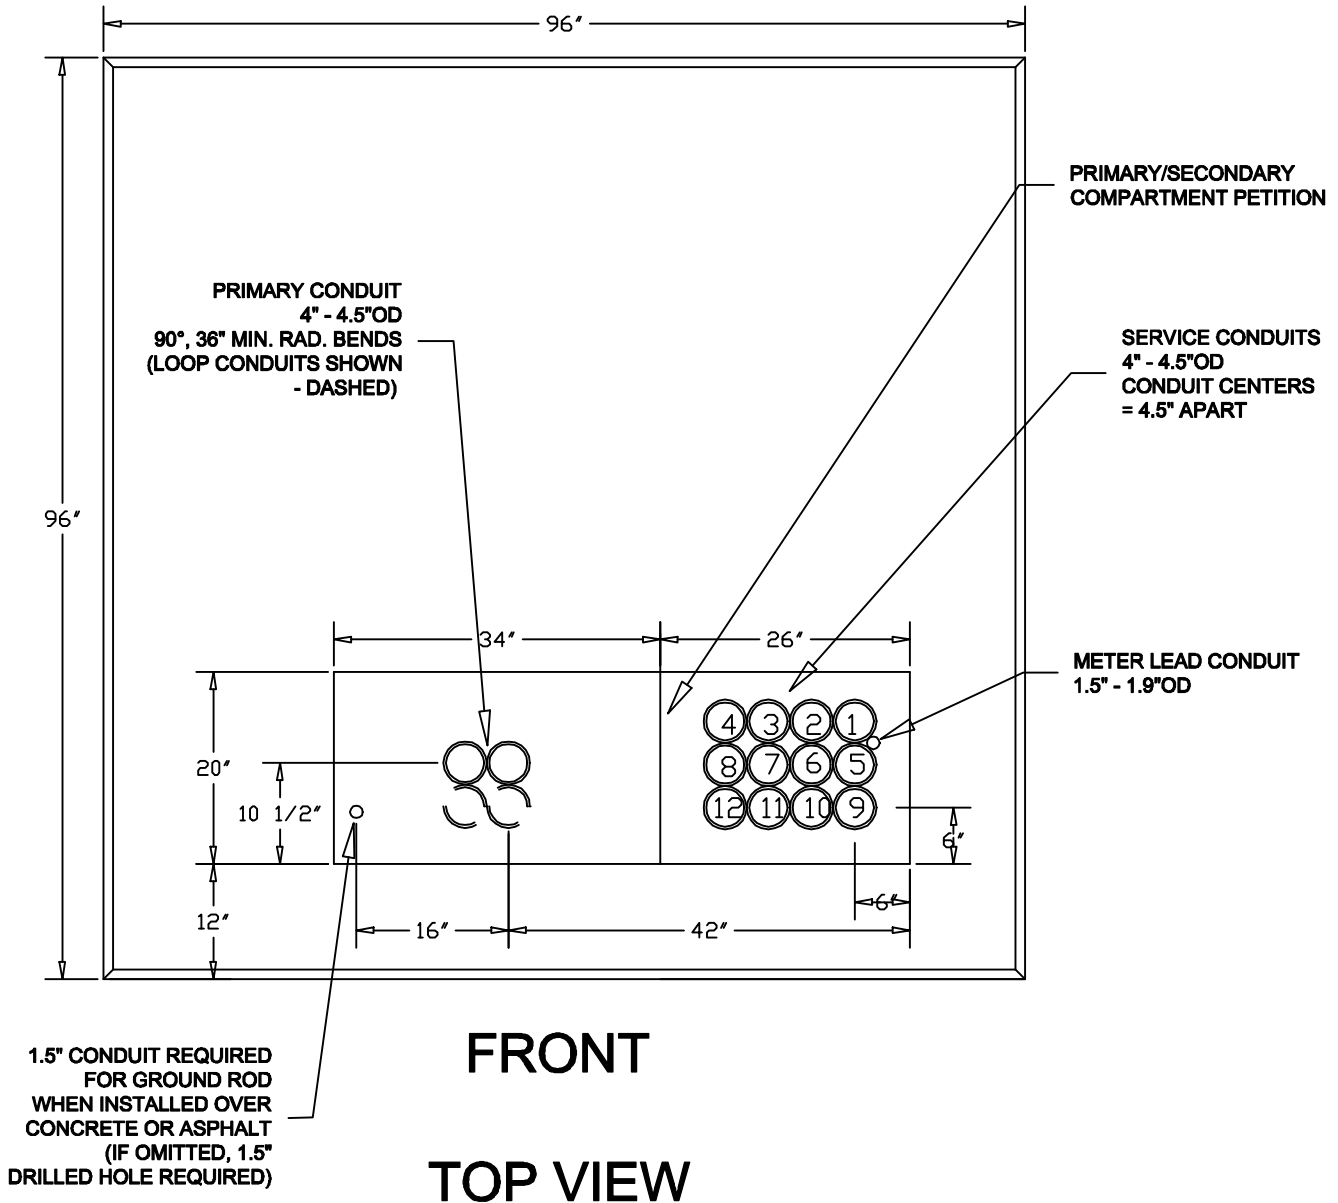

**NOTES:**

1. PLEASE REFER TO 1500-3000 T/F DRAWING FOR POURED IN PLACE PAD REQUIREMENTS.
2. CUSTOMER/CONTRACTOR TO FURNISH ALL NEMA 2-HOLE SERVICE CONNECTORS. INSTALLED BY NORTHCENTRAL.
3. 1,500kVA TRANSFORMER LIMITED TO 10 CONNECTIONS/8 WITH CTs INSTALLED IN TRANSFORMER.
4. CONDUITS SHALL BE INSTALLED IN ORDER SPECIFIED PER DRAWING
5. PLEASE SEE T/F CONN CHART FOR TYPICAL MAXIMUM NUMBER OF CONNECTIONS FOR T/F SIZE.

## 5" SECONDARY CONDUITS

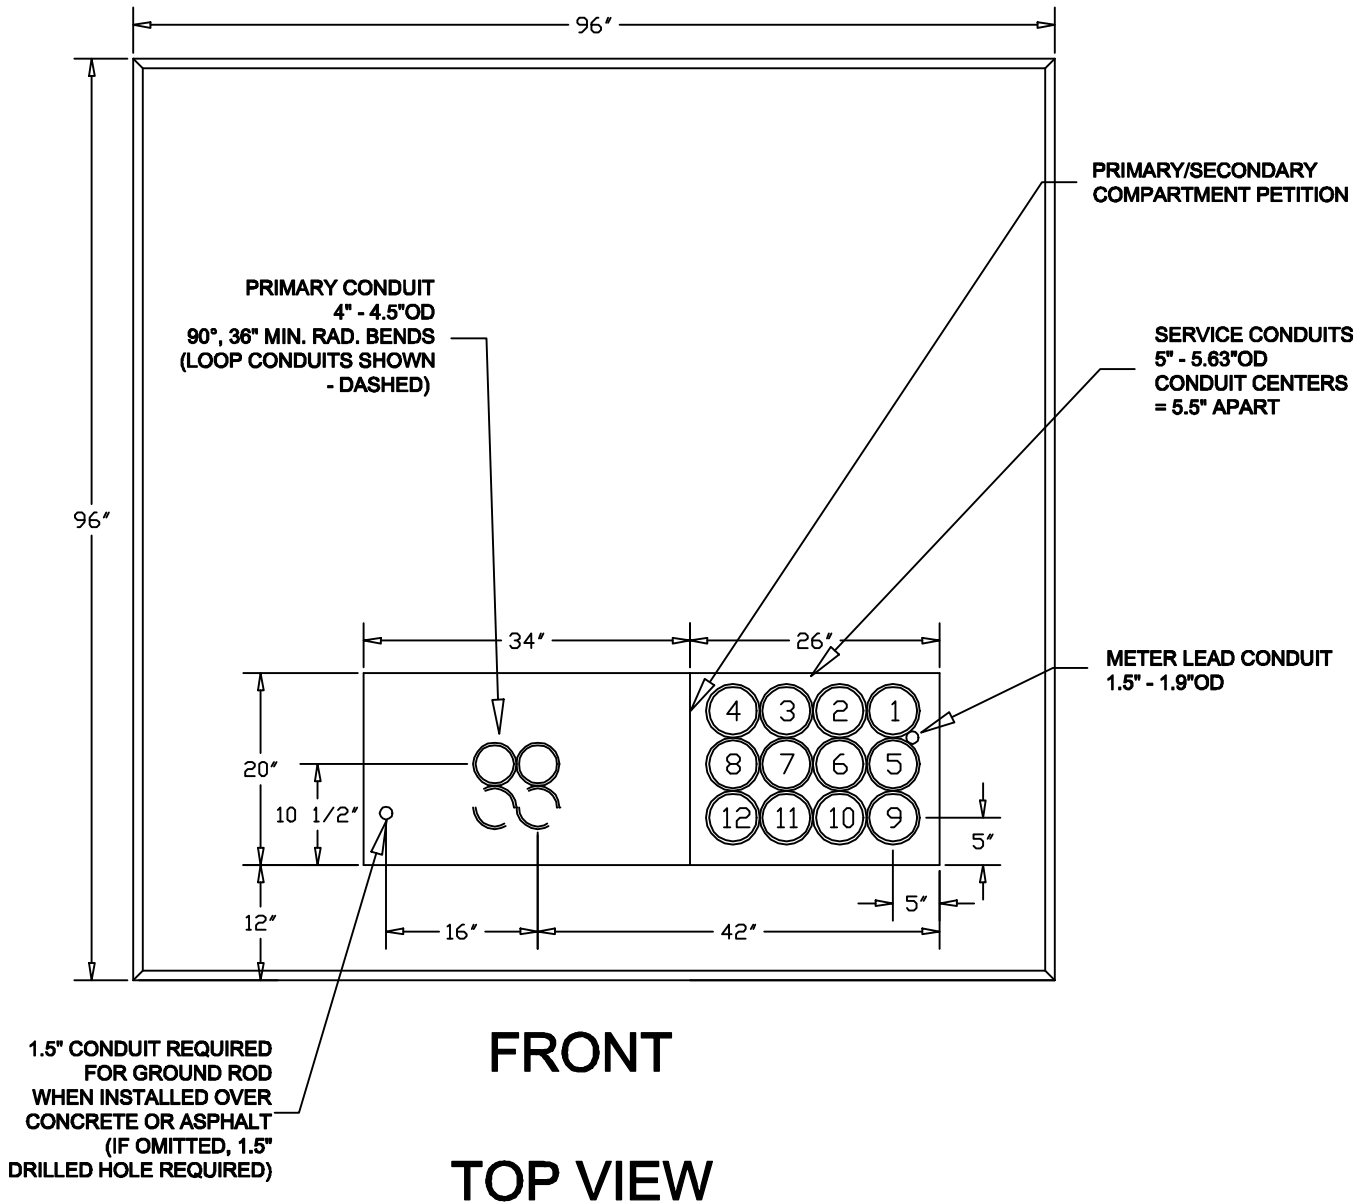

**NOTES:**

1. PLEASE REFER TO 1500-3000 T/F DRAWING FOR POURED IN PLACE PAD REQUIREMENTS.
2. CUSTOMER/CONTRACTOR TO FURNISH ALL NEMA 2-HOLE SERVICE CONNECTORS. INSTALLED BY NORTHCENTRAL.
3. 1,500kVA TRANSFORMER LIMITED TO 10 CONNECTIONS/8 WITH CTs INSTALLED IN TRANSFORMER.
4. CONDUITS SHALL BE INSTALLED IN ORDER SPECIFIED PER DRAWING
5. PLEASE SEE T/F CONN CHART FOR TYPICAL MAXIMUM NUMBER OF CONNECTIONS FOR T/F SIZE.