


# TRENCH REQUIREMENT - TYPICAL

## URD COMMERCIAL TRENCH AND CONDUIT ARRANGEMENT (TYPICAL)

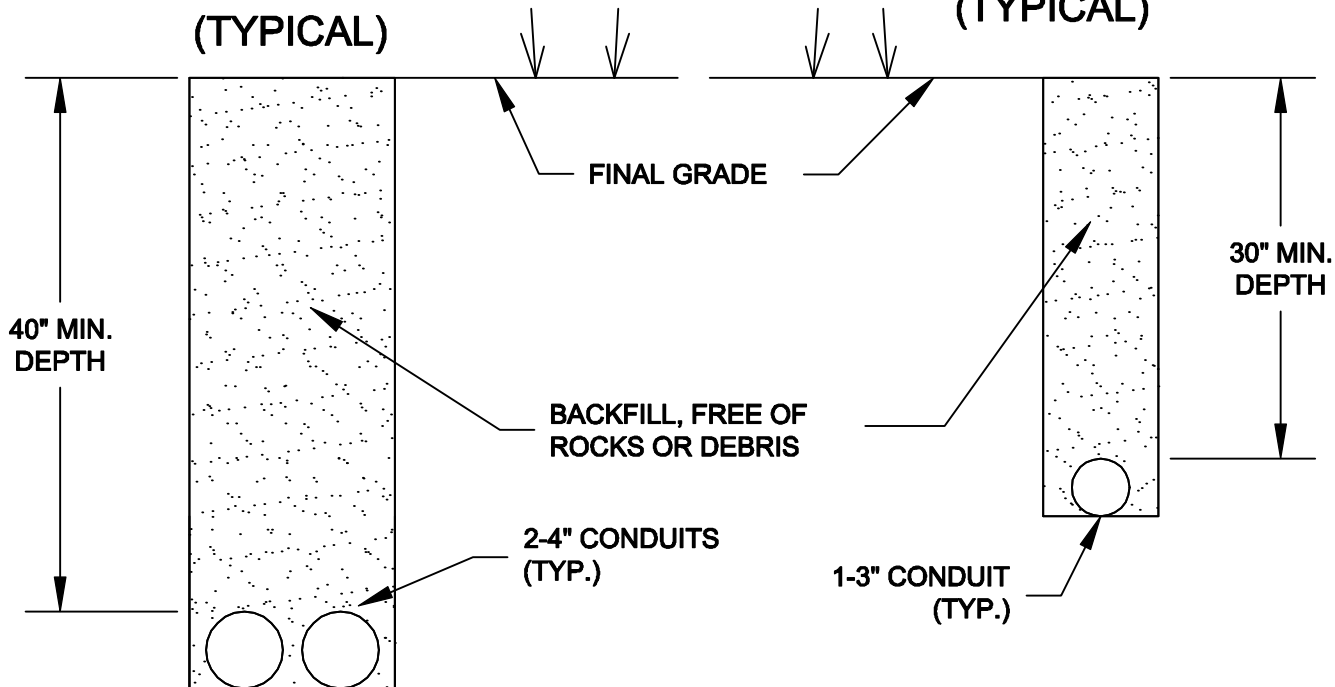

## SECONDARY/SERVICE TRENCH AND CONDUIT (TYPICAL)

## URD SUBDIVISION TRENCH AND CONDUIT ARRANGEMENT (TYPICAL)

**NOTES:**

1. MINIMUM DEPTHS ARE MEASURED TO THE TOP OF CONDUITS.
2. BACKFILL SHALL BE FREE OF SHARP ROCKS, CONSTRUCTION DEBRIS, AND REFUSE.
3. DRAWINGS SHOWN ARE FOR EXAMPLE ONLY. REFER TO SKETCH OR INSTRUCTIONS PROVIDED BY STAKING TECHNICIAN.

